
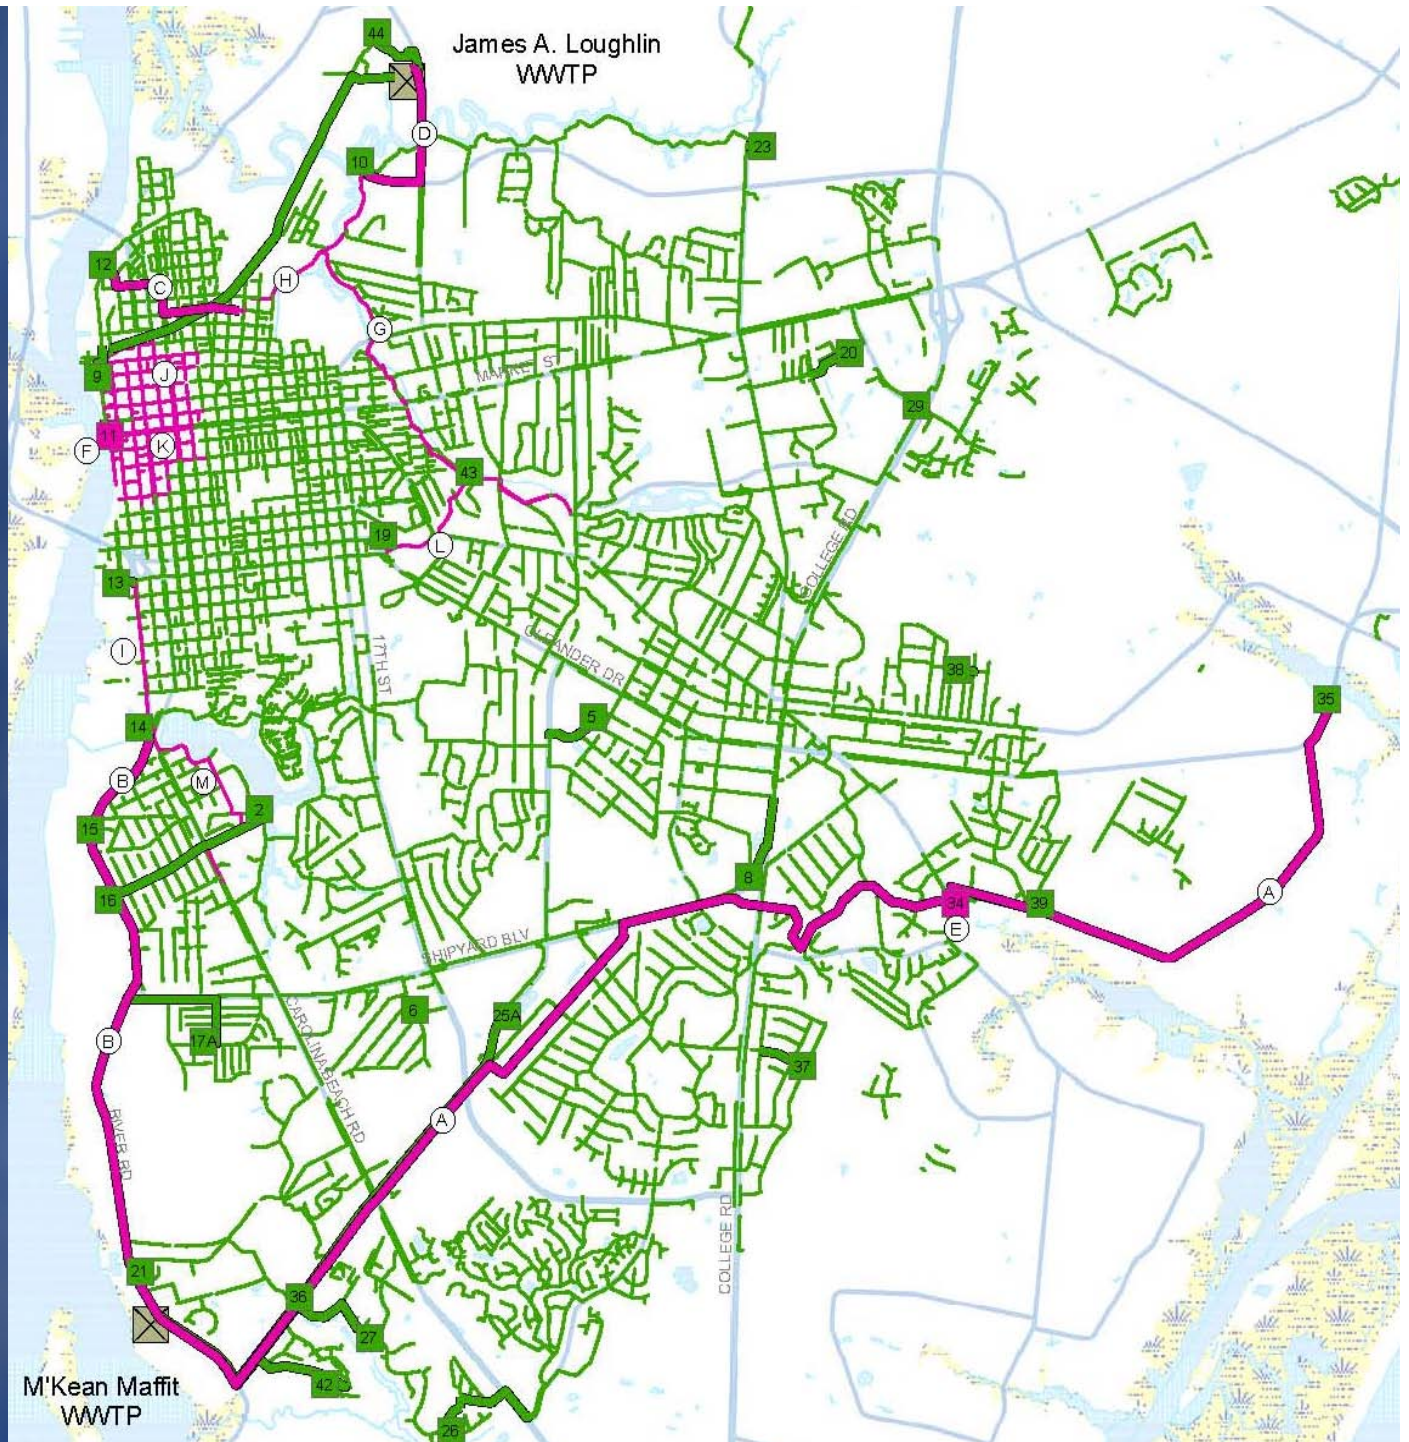


Highest Priority Projects from “Immediate Action” Category

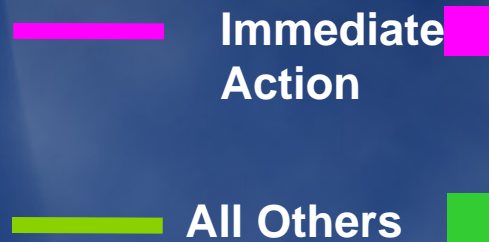

Highest Priority Project Status

Project ID – Name	Investigation Status
B-River Road Force Main	Underway (CDM)
C-PS12 Force Main	Underway (CDM)
D-PS10 Force Main	Underway (CDM)
G-Burnt Mill Creek Outfall	Underway (CDM)
K-Downtown Sewershed 11	Underway (CDM)
M-Outfall South of Greenfield Lake to PS14	Underway (CDM)
I-Front Street Interceptor	Underway (CDM)
F-Pump Station 11	Complete
J-Downtown Sewers Contributing to PS9	Complete
A-Northeast Interceptor (NEI)	Underway (KH)
E-Pump Station 34	Underway (KH)
H-McCumber's Ditch Outfall	Complete, Rehabilitated
L-Mineral Springs Interceptor	Complete, Rehabilitated

Project B: River Road Force Main

- ◆ 18,500 feet
- ◆ 20- and 24-inch Pipe
- ◆ PCCP and DIP




Project C: Pump Station 12 Force Main

- ◆ 5,300 feet
- ◆ 20-inch DIP




Project D: Pump Station 10 Force Main

- ◆ 5,300 feet
- ◆ 30-inch DIP
- ◆ Elevated Over Smith Creek

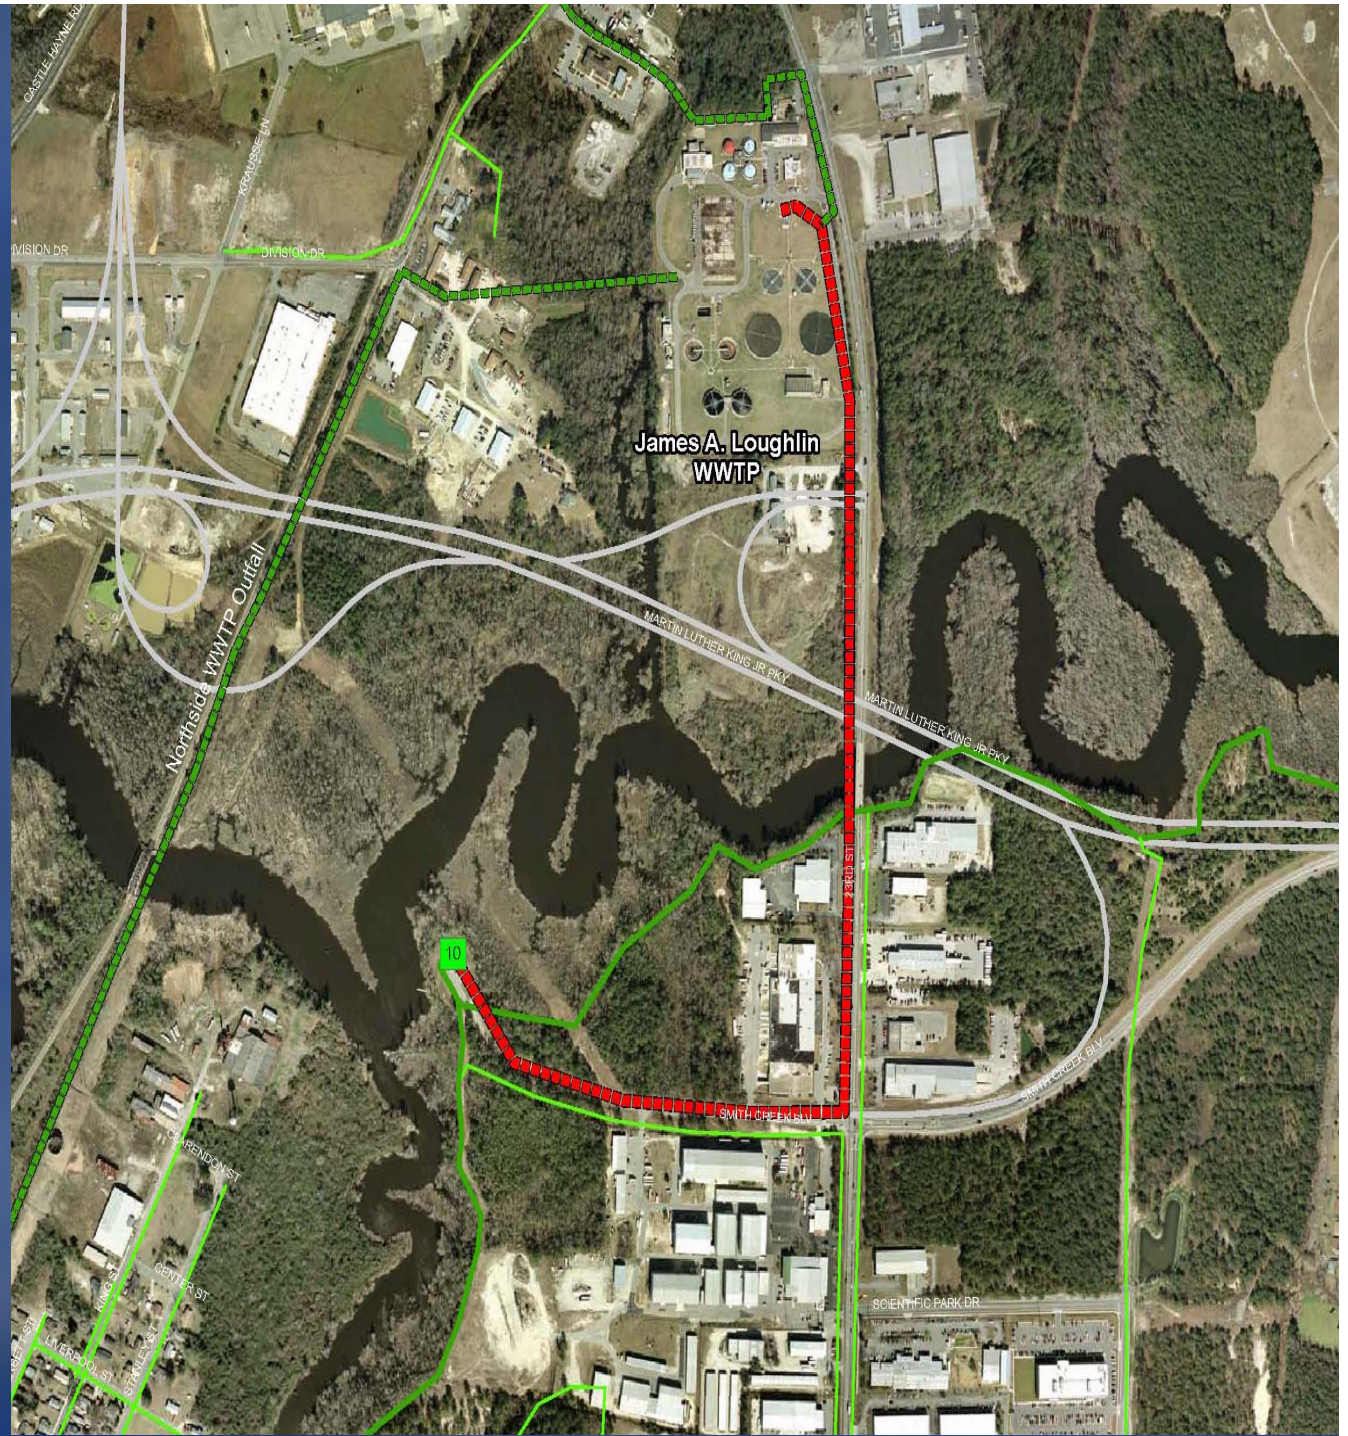

Ultrasonic Investigations of Ductile Iron Pipe Were Performed to Identify Corrosion Problems

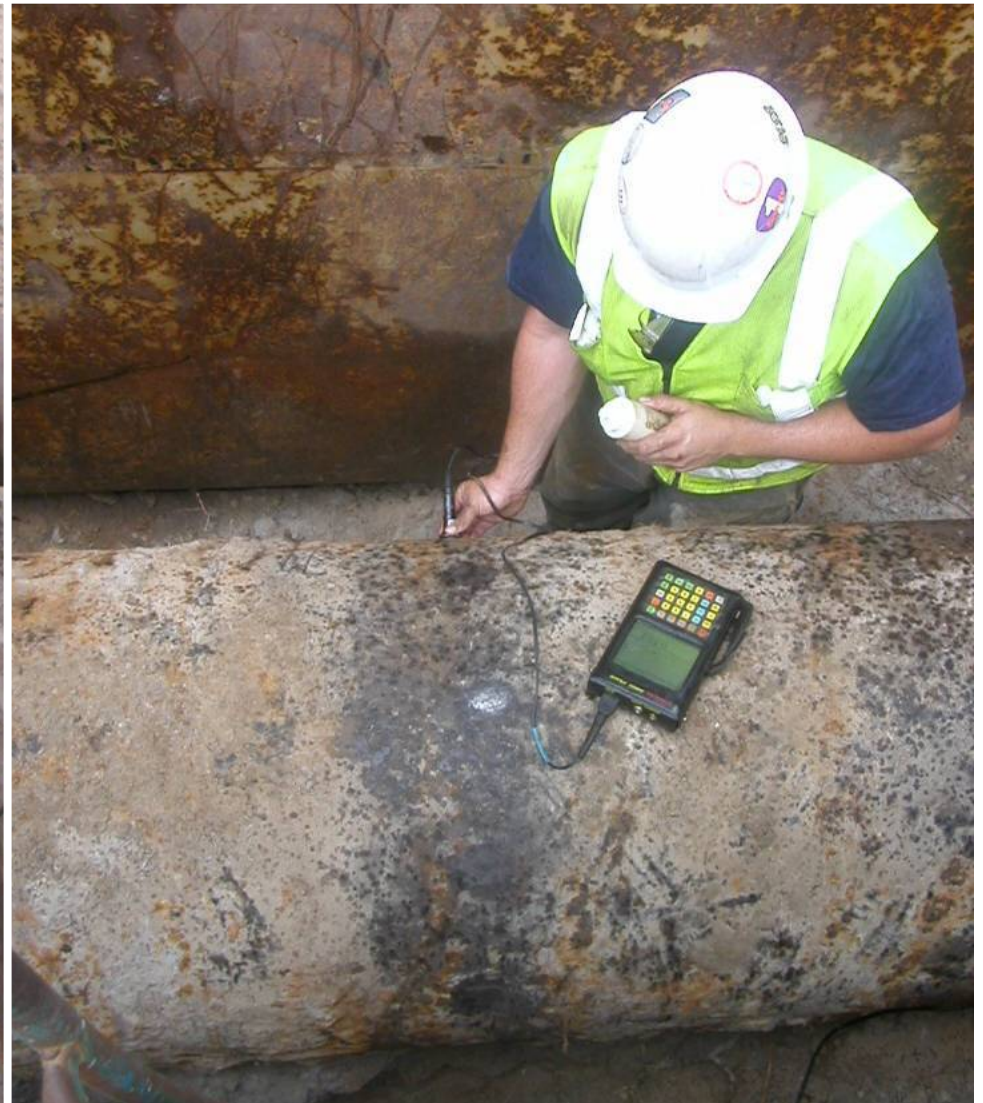


Pipe Coupons Provide Ultrasonic Calibration and Corrosion Verification



Gravity Sewer Investigation

- ◆ Manhole and Zoom Camera Inspection

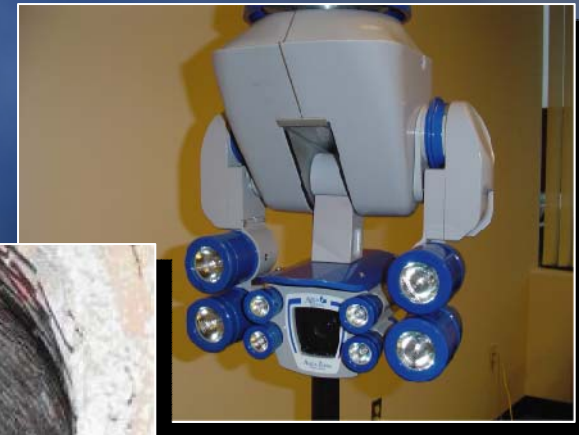

Project G: Burnt Mill Creek Outfall

- ◆ 3,100 Feet
- ◆ 48-inch RCP/DIP
- ◆ 18 Manholes



Project K: Downtown Sewer Contributing to PS11

- ◆ 1,300 Feet 6-inch
- ◆ 25,600 Feet 8-inch
- ◆ 500 Feet 10-inch
- ◆ 1,400 Feet 12-inch
- ◆ 131 Manholes



Project M: Outfall to PS14 South of Greenfield Lake

- ◆ 7,500 Feet
- ◆ 12-inch VCP
- ◆ 30 Manholes



Project I: Front Street Interceptor

- ◆ 3,400 Feet
- ◆ 15 & 18-inch VCP/RCP
- ◆ 15 Manholes



Current Phase 2 Status and Schedule:

- ◆ **Completed Field Investigation of High Priority Projects**
- ◆ **Analyzing Results and Preparing Conclusions**
- ◆ **Present Results and Conclusions to Council next week**
- ◆ **Draft report in November with recommendations and costs**
- ◆ **Update to Council with recommendations and costs in December**